


Castelnau Library, Barnes

The following graphs represent levels of carbon monoxide and nitrogen dioxide monitored at Castelnau Library from November 1999 to April 2000. The graphs indicate that the guidance levels were not exceeded during this monitoring period. A permanent static site is now positioned at the front of the library, 3 metres from the main road

**Nitrogen Dioxide (NO₂)
Hourly Mean
Limit=105ppb**

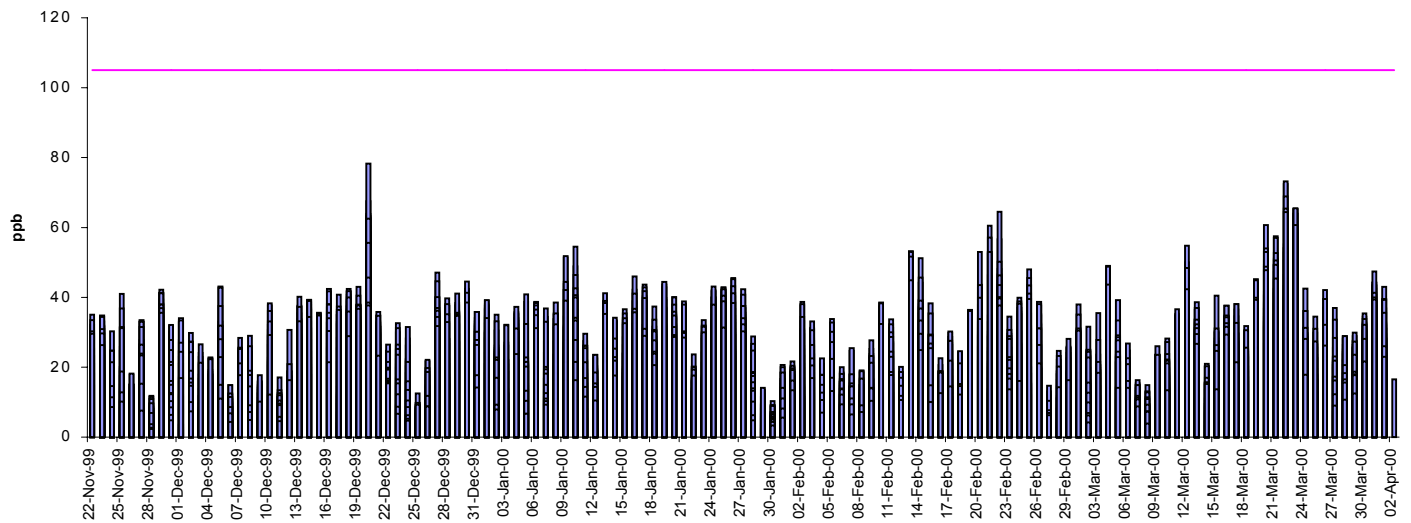

**Carbon Monoxide (CO)
Running 8 Hour Mean
Limit=10ppm**

